

ACCESSIBILITY NOTES:
1. THE INTERNATIONAL SYMBOL OF ACCESSIBILITY SIGN SHALL BE DISPLAYED AT ALL ACCESSIBLE RESTROOM FACILITIES AND AT ACCESSIBLE BUILDING ENTRANCES UNLESS ALL ENTRANCES ARE ACCESSIBLE. ACCESSIBLE ENTRANCES SHALL HAVE A MINIMUM CLEARANCE OF 80 INCHES. DIRECTIONAL SIGNS INDICATING THE ROUTE TO THE NEAREST ACCESSIBLE ENTRANCE.
2. ACCESSIBLE DRINKING FOUNTAINS SHALL HAVE A SPOUT HEIGHT NO HIGHER THAN 36 INCHES ABOVE THE FLOOR AND EDGE OF BASIN NO HIGHER THAN 34 INCHES ABOVE THE FLOOR FOR INDIVIDUALS IN WHEELCHAIRS. ADDITIONAL DRINKING WATER PROVISIONS SHALL BE MADE FOR INDIVIDUALS WHO HAVE DIFFICULTY BENDING.
3. WHERE STORAGE FACILITIES SUCH AS CABINETS, SHELVES, CLOSETS AND DRAWERS ARE PROVIDED AT LEAST ONE TYPE PROVIDING STORAGE SPACE COMPLYING WITH THE FOLLOWING: DOORS ETC. TO SUCH SPACES SHALL BE ACCESSIBLE (I.E. TOUCH LATCHES, U-SHAPED PULLS); SPACES SHALL BE 15 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FLOOR. REAR OR SIDE REACH; CLOTHES RODS OR COAT HOOKS SHALL BE A MAXIMUM OF 48 INCHES ABOVE THE FLOOR (46 INCHES MAXIMUM WHEN DISTANCE FROM WHEEL CHAIR TO ROD EXCEEDS 10 INCHES). SHELVES IN KITCHENS OR TOILET ROOMS SHALL BE 40 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE IN FLOOR.
4. CONTROLS, DISPENSERS, RECEPTACLES AND OTHER OPERABLE EQUIPMENT SHALL BE NO HIGHER THAN 48 INCHES ABOVE THE FLOOR. RECEPTACLES ON WALLS SHALL BE MOUNTED NO LESS THAN 15 INCHES ABOVE THE FLOOR. EXCEPTION: HEIGHT LIMIT DOES NOT APPLY WHERE THE USE OF SPECIAL EQUIPMENT DICTATES OTHERWISE OR WHERE ELECTRICAL RECEPTACLES ARE NOT NORMALLY INTENDED FOR USE BY BUILDING OCCUPANTS.
5. WHERE EMERGENCY WARNING SYSTEMS ARE PROVIDED, THEY SHALL INCLUDE BOTH AUDIBLE AND VISUAL ALARMS. THE VISUAL ALARMS SHALL BE LOCATED THROUGHOUT, INCLUDING RESTROOM, AND PLACED 80 INCHES ABOVE THE FLOOR OR 6 INCHES BELOW CEILING,WHICH--EVER IS LOWER.
6. ALL DOORS SHALL BE OPENABLE BY A SINGLE EFFORT. DOOR CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO AN OPEN POSITION OF 12 DEGREES SHALL BE 5 SECONDS MINIMUM. THE MAXIMUM FORCE REQUIRED FOR PUSHING OR PULLING OPEN DOORS OTHER THAN FIRE DOORS SHALL NOT EXCEED 5 LBS. FOR ALL SLIDING, FOLDING, AND INTERIOR HINGED DOORS.
7. FLOOR SURFACES SHALL BE STABLE, FIRM, AND SLIP-RESISTANT. CHANGES IN LEVEL BETWEEN 0.25 INCH AND 0.5 INCH SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2. CHANGES IN LEVEL GREATER THAN 0.5 INCH REQUIRE RAMP. CARPET TILE THICKNESS SHALL BE 0.5 MAX. GRATINGS IN FLOOR SHALL HAVE SPACES NO GREATER THAN 0.5 INCH WIDE IN ONE DIRECTION. DOORWAY WHEEL CHAIRS SHALL NOT EXCEED 0.5 INCH IN HEIGHT.
8. ACCESSIBLE WATER CLOSETS SHALL BE 17 INCHES TO 19 INCHES, MEASURED FROM THE FLOOR TO THE TOP OF THE SEAT. GRAB BARS SHALL BE 36 INCHES LONG MINIMUM WHEN LOCATED BEHIND WATER CLOSET AND 42 INCHES MINIMUM WHEN LOCATED ALONG SIDE OF WATER CLOSET. GRAB BARS SHALL BE MOUNTED 33 INCHES TO 36 INCHES ABOVE THE FLOOR. IN ADDITION, A VERTICAL GRAB BAR 18 INCHES MINIMUM IN LENGTH SHALL BE MOUNTED ON THE SIDEWALL WITH THE BOTTOM OF THE BAR LOCATED BETWEEN 39 AND 41 INCHES ABOVE THE FLOOR, AND WITH THE CENTER LINE OF THE BAR LOCATED BETWEEN 39 INCHES AND 41 INCHES FROM THE REAR WALL.
9. ACCESSIBLE URINALS SHALL BE STALL-TYPE OR WALL HUNG WITH ELONGATED RIMS AT A MAXIMUM OF 17 INCHES ABOVE THE FLOOR.
10. ACCESSIBLE LAVATORIES AND SINKS SHALL BE MOUNTED WITH THE RIM NO HIGHER THAN 34 INCHES ABOVE THE FLOOR. KNEE CLEARANCE OF AT LEAST 27 INCHES HIGH MUST BE PROVIDED WITH A MINIMUM DEPTH OF 8 INCHES BENEATH THE FIXTURE AND 9 INCHES HIGH MINIMUM WITH A MINIMUM DEPTH OF 11 INCHES BENEATH THE FIXTURE. THE KNEE SPACE MUST BE AT LEAST 30 INCHES WIDE.
11. HOT WATER AND DRAIN PIPES UNDER ACCESSIBLE LAVATORIES AND SINKS SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. INSULATION OR PROTECTION MATERIALS MAY BE SITE INSTALLED. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER ACCESSIBLE LAVATORIES AND SINKS.
12. MIRRORS LOCATED ABOVE LAVATORIES, SINKS OR COUNTERS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE A MAXIMUM OF 40 INCHES ABOVE THE FLOOR. OTHER MIRRORS IN TOILET ROOMS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 35 INCHES MAXIMUM ABOVE THE FLOOR.
13. GRAB BARS HAVING A CIRCULAR CROSS SECTION SHALL HAVE AN OUTSIDE DIAMETER OF 1.25 INCHES MINIMUM AND 2.0 INCHES MAXIMUM. THE SPACE BETWEEN THE GRAB BAR AND THE WALL SHALL BE 1.5 INCHES.
14. WATER CLOSET FLUSH CONTROL SHALL BE INSTALLED A MAXIMUM OF 36 INCHES ABOVE THE FLOOR AND SHALL BE LOCATED ON THE OPEN SIDE OF THE WATER CLOSET.
15. DOORS TO ALL ACCESSIBLE SPACES SHALL HAVE ACCESSIBLE HARDWARE (I.E. LEVER -- OPERATED, PUSH/TYPE, U-SHAPED) MOUNTED WITH OPERABLE PARTS BETWEEN 34 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FLOOR.
16. TOILET STALL DOORS SHALL BE THE SELF-CLOSING TYPE.
17. A TOWEL DISPENSER SHALL BE LOCATED ADJACENT TO ALL ACCESSIBLE LAVATORIES.

GENERAL NOTES:
1. ACCESS TO BUILDING FOR PERSONS IN WHEELCHAIRS IS DESIGNED BY AND FIELD BUILT BY OTHERS AND SUBJECT TO LOCAL JURISDICTION APPROVAL. THE PRIMARY ENTRANCE MUST BE ACCESSIBLE.
2. ALL DOORS SHALL BE OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OR EFFORT. MANUALLY OPERATED FLUSH BOLTS OR SURFACE BOLTS SHALL NOT BE USED.
3. ALL GLAZING WITHIN A 24 INCH ARC OF DOORS, WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES ABOVE THE FLOOR, AND ALL GLAZING IN DOORS SHALL BE SAFETY, TEMPERED OR ACRYLIC PLASTIC SHEET.
4. ALL STEEL STRAPS REFERENCED ON FLOOR PLAN SHALL BE 1.5 INCH x 26 GA. WITH 6 - 15 GA. x 7/16 INCH CROWN x 1 INCH STAPLES EACH END OF STRAP OR EQUIVALENT FROM RIDGE BEAM TO COLUMN, AND COLUMN TO FLOOR.
5. PORTABLE FIRE EXTINGUISHER PER N.F.P.A. - 10 INSTALLED BY OTHERS ON SITE, AND SUBJECT TO LOCAL JURISDICTION.
6. PROVISIONS FOR EXIT DISCHARGE LIGHTING ARE THE RESPONSIBILITY OF THE BUILDING OWNER AND SUBJECT TO LOCAL JURISDICTION APPROVAL WHEN NOT SHOWN ON THE FLOOR PLAN (INCLUDING EMERGENCY LIGHTING, WHEN REQUIRED).
7. WHEN LOW SIDES OF ROOF PROVIDE LESS THAN 6" OF OVERHANG, GUTTERS AND DOWN SPOUTS SHALL BE SITE INSTALLED, DESIGNED BY OTHERS, SUBJECT TO LOCAL JURISDICTION APPROVAL.
8. IN WIND-BORNE-DEBRIS REGIONS, GLAZING SHALL BE IMPACT RESISTANT OR PROTECTED WITH AN IMPACT RESISTANT COVERING MEETING THE REQUIREMENTS OF AN APPROVED IMPACT RESISTANT STANDARD, OR ASTM E1996. WIND-BORNE-DEBRIS REGIONS ARE DESIGNATED IN SECTION 1609 OF THE IBC.
9. FIRE SAFETY PLAN REVIEW AND INSPECTION IS RESERVED FOR THE LOCAL AUTHORITY HAVING JURISDICTION.
10. WINDOWS AND DOORS MUST BE CERTIFIED FOR COMPLIANCE WITH THE WIND DESIGN PRESSURE FOR COMPONENTS AND CLADDING.
11. STRUCTURAL DETAILS NOT INCLUDED IN THIS PLAN SET ARE TO BE CONSTRUCTED ACCORDING TO THE MANUFACTURERS STATE APPROVED BUILDING SYSTEM MANUAL.

LOUISIANA NOTES: (IF APPLICABLE)
1. Exterior site related items shall be addressed by the local engineer and/or contractor, and are out of the limitations of this approval. Such items are including, but not limited to: ramps, site plan, parking spaces, location of building with respect to property lines, exterior lighting, access to public ways, stairs handrails and site related utilities.
2. This approval is for the building design and construction only. All accessibility related items listed are based on the 28 CFR Part 36, of the ADA Standards for Accessible Design.
4. The centerline of accessible toilets shall be 18" from the nearest adjacent wall.
5. Lavatories shall meet the criteria listed in Acc. Note # 10.
6. Hot water drain pipes shall be insulated or covered.
7. Faucets shall meet the criteria listed in Acc. Note # 10.
8. Mirrors shall meet the criteria listed in Acc. Note # 12.
9. Toilet room grab bars shall comply with Acc. Note # 8.
10. A 60" diameter clear floor space shall be provided within each occupiable room for turning.
11. All doors provided provide a minimum 32" clear width.
12. Maneuvering clearances at doors comply with figure 404.2.4.1.
13. Thresholds shall comply with Acc. Note # 15.
14. Changes in floor elevation shall comply with Acc. Note # 7.
15. See note # 1 regarding ramps and stairs.
16. Permanent signage shall comply with ADA 703.1.
A. Signage, where provided for permanent rooms and spaces shall provide:
(1). Braille and raised lettering as per 703.3
(2). Letter/symbol to background color contrast per 703.5.1
(3). A 60" height from floor to centerline of sign
B. Other permanent signs which provide direction to or information about functional spaces of the building shall provide:
(1). Letter character width to height proportion per 703.5.4
(2). Character height proportion based on height of sign from finish floor per 703.5.5, and
(3). Letter/symbol to background color contrast per 703.5.1.
17. Locks on doors in means of egress shall not require the use of a key, special device or special knowledge to open.
18. Door shall be capable of being opened with ONLY one releasing operation. Knobs w/ independent side bolts are not acceptable.
19. Interior walls and ceilings shall have a flame spread of 0-200 and a smoke developed rating of 0-450.
20. Fire extinguishers, installed on site by others, shall comply with NFPA 10.

MECHANICAL NOTES:
1. ALL SUPPLY AIR REGISTERS SHALL BE 10 INCHES x 10 INCHES ADJUSTABLE WITH 10 INCHES x 20 INCHES (INSIDE) OVERHEAD FIBERGLASS DUCT, UNLESS OTHERWISE SPECIFIED. DUCTS IN UNCONDITIONED SPACES SHALL HAVE R-8 MINIMUM INSULATION EXCEPT DUCTS EXPOSED TO VENTILATED ATTICS AND CRAWL SPACES SHALL HAVE R-8 INSULATION.
2. INTERIOR DOORS SHALL BE UNDERCUT 1.5 INCHES ABOVE FINISHED FLOOR FOR AIR RETURN AND/OR AS NOTED ON FLOOR PLAN.
3. HVAC EQUIPMENT SHALL BE EQUIPPED WITH OUTSIDE FRESH AIR INTAKES PROVIDING 5 CFM FOR EACH OCCUPANT AND 0.06 AREA-OUTDOOR RATE PER IMC SECTION 403.
4. RESTROOM VENT FANS SHALL PROVIDE 75 CFM OR MORE EXHAUST PER WATER CLOSET OR URINAL.
5. RESTROOM VENT FANS SHALL BE DUCTED DIRECTLY TO EXTERIOR OF BUILDING.
6. PERMISSIBLE TYPE OF GAS FOR APPLIANCES-NONE (ALL ELECTRIC)

ELECTRICAL NOTES:
1. ALL CIRCUITS AND EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH THE APPROPRIATE ARTICLES OF THE NATIONAL ELECTRICAL CODE (NEC).
2. WHEN LIGHT FIXTURES ARE INSTALLED IN CLOSETS THEY SHALL BE SURFACE MOUNTED OR RECESSED. INCANDESCENT FIXTURES SHALL HAVE COMPLETELY ENCLOSED LAMPS. SURFACE MOUNTED INCANDESCENT FIXTURES SHALL HAVE A MINIMUM CLEARANCE OF 12 INCHES AND ALL OTHER FIXTURES SHALL HAVE A MINIMUM CLEARANCE OF 6 INCHES FROM "STORAGE AREA" AS DEFINED BY NEC 410-8(G).
3. WHEN WATER HEATERS ARE INSTALLED THEY SHALL BE PROVIDED WITH READILY ACCESSIBLE DISCONNECTS ADJACENT TO THE WATER HEATERS SERVED. THE BRANCH CIRCUIT SWITCH OR CIRCUIT BREAKER SHALL BE PERMITTED TO SERVE AS THE DISCONNECTING MEANS ONLY WHERE THE SWITCH OR CIRCUIT BREAKER IS WITHIN SIGHT FROM THE WATER HEATER OR IS CAPABLE OF BEING LOCKED IN THE OPEN POSITION.
4. HVAC EQUIPMENT SHALL BE PROVIDED WITH READILY ACCESSIBLE DISCONNECTS ADJACENT TO THE EQUIPMENT SERVED. A UNIT SWITCH WITH A MARKED "OFF" POSITION THAT IS A PART OF THE HVAC EQUIPMENT AND DISCONNECTS ALL UNGROUNDED CONDUCTORS SHALL BE PERMITTED AS THE DISCONNECTING MEANS WHERE OTHER DISCONNECTING MEANS ARE ALSO PROVIDED BY A READILY ACCESSIBLE CIRCUIT BREAKER.
5. PRIOR TO ENERGIZING THE ELECTRICAL SYSTEM THE INTERRUPTING RATING OF THE MAIN BREAKER MUST BE DESIGNED AND VERIFIED AS BEING IN COMPLIANCE WITH SECTION 110-9 OF THE NEC BY LOCAL ELECTRICAL CONSULTANT.
6. THE MAIN ELECTRICAL PANEL AND FEEDERS ARE DESIGNED BY OTHERS, SITE INSTALLED AND SUBJECT TO LOCAL JURISDICTION APPROVAL.
7. ALL CIRCUITS CROSSING OVER MODULE MATING LINE(S) SHALL BE SITE CONNECTED WITH APPROVED ACCESSIBLE JUNCTION BOXES, OR CABLE CONNECTORS.
8. ALL RECEPTACLES INSTALLED IN WET LOCATIONS (EXTERIOR) SHALL BE IN WEATHER PROOF (WP) ENCLOSURES. THE INTEGRITY OF WHICH IS NOT AFFECTED WHEN AN ATTACHMENT PLUG CAP IS INSERTED OR REMOVED. THE RECEPT ITSELF SHALL ALSO BE LISTED FOR DAMP AND WET LOCATIONS.
9. EXTERIOR LIGHTS NOT INTENDED FOR 24 HOUR USE SHALL BE CONNECTED TO A PHOTOCELL OR TIMER.

PLUMBING NOTES:
1. TOILETS SHALL BE ELONGATED WITH NONABSORBENT OPEN FRONT SEATS.
2. REST ROOM WALLS SHALL BE COVERED WITH NONABSORBENT MATERIAL TO A MINIMUM HEIGHT OF 48 INCHES A.F.F. FLOORS SHALL HAVE SMOOTH, HARD, NONABSORBENT SURFACE THAT EXTENDS UPWARD ONTO THE WALLS AT LEAST 6 INCHES.
3. THIS UNIT MUST BE CONNECTED TO A PUBLIC WATER SUPPLY AND SEWER SYSTEM IF THESE ARE AVAILABLE.
4. ALL PLUMBING FIXTURES SHALL HAVE SEPARATE SHUTOFF VALVES.
5. WATER HEATER SHALL HAVE SAFETY PAN WITH 1 INCH DRAIN TO EXTERIOR, T&P RELIEF VALVE WITH DRAIN TO EXTERIOR, AND A SHUT OFF VALVE WITHIN 3 FEET ON A COLD WATER SUPPLY LINE.
6. DWV SYSTEM SHALL BE EITHER ABS OR PVC -- DWV.
7. WATER SUPPLY LINES SHALL BE CPVC, OR COPPER; AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS LIMITATIONS AND INSTRUCTIONS.
8. WATER CLOSETS ARE TANK TYPE AND URINALS ARE FLUSH TANK TYPE UNLESS OTHERWISE SPECIFIED.
9. BUILDING DRAIN AND CLEANOUTS ARE DESIGNED AND SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL JURISDICTION APPROVAL.
10. SHOWERS SHALL BE CONTROLLED BY AN APPROVED MIXING VALVE WITH A MAXIMUM WATER OUTLET TEMPERATURE OF 120°F (48.8°C).
11. THERMAL EXPANSION DEVICE, IF REQUIRED BY WATER HEATER INSTALLED, AND IF NOT SHOWN ON PLUMBING PLAN, IS DESIGNED AND SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL APPROVAL.
12. WATER PIPES INSTALLED IN A WALL EXPOSED TO THE EXTERIOR SHALL BE LOCATED ON THE HEATED SIDE OF THE WALL. INSULATION. WATER PIPING INSTALLED IN AN UNCONDITIONED ATTIC SHALL BE INSULATED WITH AN INSULATION OF R-6.5 MINIMUM.
13. PIPING IN UNCONDITIONED SPACES MUST BE PROTECTED WITH INSULATION HAVING A MINIMUM R FACTOR OF 6.5 IN ACCORDANCE WITH SECTION 305.6.
14. BUILDINGS WITHOUT THE MINIMUM REQUIRED PLUMBING FIXTURES IS SUBJECT TO JURISDICTION HAVING AUTHORITY.
15. THE WATER HEATER SHALL HAVE CONTROLS TO ALLOW A SET POINT OF 90 DEGREES F. THE OUTLET TEMPERATURE OF LAVATORIES SHALL BE LIMITED TO 110 DEGREES F.
16. THE WATER HEATER SHALL BE PLUMBED WITH HEAT TRAPS ON THE SUPPLY AND DISCHARGE PIPING CONNECTED TO THE HEATER.
17. THE FIRST 8 FEET OF HOT WATER PIPING FROM THE WATER HEATER SHALL BE INSULATED WITH 0.5 INCH OF MATERIAL HAVING A CONDUCTIVITY NOT EXCEEDING 0.27 BTU PER INCH / ft x ft x F.
18. TREATED WATER MUST BE DELIVERED THROUGH AN APPROVED WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 OR CSA B125.3.

BUILDING DESIGN PARAMETERS
1. USE/OCCUPANCY: BUSINESS
2. CONSTRUCTION TYPE: VB
3. SPRINKLER SYSTEM: NO
4. BUILDING AREA: 875 S.F.
5. BUILDING HEIGHT: ≤ 15 FEET
6. NUMBER OF STORIES: 1
7. NUMBER OF MODULES: 1
8. OCCUPANT LOAD _a_ BASED ON 100_SF/PERSON
9. EXTERIOR WALL FIRE RATING: NOT RATED
10. THIS BUILDING MUST BE INSTALLED WITH THE FIRE SEPARATION DISTANCES REQUIRED BY IBC TABLE 602 AND SECTION 705.3
11. ENERGY CODE COMPLIANCE: SEE ATTACHED ENERGY CALCULATIONS
12. MANUFACTURERS DATA PLATE, STATE LABELS AND 3RD PARTY LABELS ARE TO BE LOCATED ADJACENT TO ELECTRICAL PANEL.

STRUCTURAL LOAD LIMITATIONS
FLOOR LIVE LOAD: A. 50 PSF B. 2000 LB. CONCENTRATED LOAD OVER 30 INCH x 30 INCH AREA LOCATED ANYWHERE ON FLOOR
ROOF LIVE LOAD: A. 20 PSF
ROOF SNOW LOAD: A. Pg = 20 PSF GROUND SNOW LOAD B. Pf = 20 PSF FLAT ROOF SNOW LOAD C. Ce = 1.0 SNOW EXPOSURE FACTOR D. Sd = 1.0 SNOW IMPORTANCE FACTOR E. Ct = 1.1 SNOW THERMAL FACTOR
WIND LOAD: ASCE 7-10 A. ULTIMATE WIND SPEED (3-SEC GUST): Vult=180 MPH B. NOMINAL WIND SPEED (3-SEC GUST): Vsd=140 MPH C. RISK CATEGORY: II D. WIND EXPOSURE CATEGORY: EXP.=C E. INTERNAL PRESSURE COEFFICIENT: Gcp=0.18 F. COMPONENT & CLADDING ULTIMATE DESIGN PRESSURES (NOMINAL DESIGN PRESSURE) FOR ROOF ANGLES 0 TO 7 DEGREES: WALL ZONE 5: Pult=+/-94.4 PSF (Posd=+/-56.6 PSF) WALL ZONE 4: Pult=+/-76.5 PSF (Posd=+/-48.9 PSF) ROOF ZONE 3: Pult=-178.1 PSF (Posd=-106.9 PSF) ROOF ZONE 2: Pult=-118.3 PSF (Posd=-71.0 PSF) ROOF ZONE 1: Pult=-70.5 PSF (Posd=-42.3 PSF)
SEISMIC LOAD: A. Ie = 1.0 SEISMIC IMPORTANCE FACTOR B. Ie = 1.0 SITE CLASS C. A13 SEISMIC FORCE RESISTING SYSTEM. D. C SEISMIC DESIGN CATEGORY E. EQUIVALENT LATERAL FORCE ANALYSIS PROCEDURE Sa = 0.337 MAPPED SPECTRAL RESPONSE COEF. G. S1 = 2.285 MAPPED SPECTRAL RESPONSE COEF. H. Sds = 0.49 SPECTRAL RESPONSE COEFFICIENT I. Sd1 = 0.34 SPECTRAL RESPONSE COEFFICIENT J. V = 1957 LB DESIGN BASE SHEAR K. R = 6.5 RESPONSE MODIFICATION COEFFICIENT L. Cs = 0.08 SEISMIC RESPONSE COEFFICIENT

SPECIAL CONDITIONS AND / OR LIMITATIONS:
1. THE BUILDING DESIGN HAS BEEN APPROVED FOR USE ONLY IN THOSE AREAS WITHIN THE SCOPE OF THE STRUCTURAL LOAD LIMITATIONS AND CLIMATE DESIGN CRITERIA INDICATED BELOW.
2. SEE THE BUILDING SITE INSTALLATION REQUIREMENTS NOTES FOR WORK REQUIRING ON SITE INSPECTION
3. THE MINIMUM REQUIRED FIXTURES SHALL BE PROVIDED IN ANOTHER BUILDING LOCATED ON THE INSTALLATION SITE WITH A PATH OF TRAVEL THAT DOES NOT EXCEED 500 FEET AND THAT THE PLUMBING FACILITIES MUST BE ACCESSIBLE TO THE OCCUPANTS OF THE INDUSTRIALIZED BUILDING.
4. DRINKING WATER FACILITIES TO BE PROVIDED AND INSTALLED ON SITE BY OTHERS.
5. VENTILATION OF THE RAFTER OR ATTIC SPACE SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE LOCAL BUILDING OFFICIAL.
6. THE DESIGN OF THE BUILDING HAS NOT BEEN EVALUATED WITH THE TDI WINDSTORM INSPECTION PROGRAM REQUIREMENTS.

ATTENTION LOCAL INSPECTIONS DEPARTMENT
SITE INSTALLED ITEMS
THE FOLLOWING ITEMS HAVE NOT BEEN COMPLETED BY THE MANUFACTURER, HAVE NOT BEEN INSPECTED BY 3rd PARTY AND ARE NOT CERTIFIED BY THE STATE MODULAR LABEL. NOTE THAT THIS LIST DOES NOT NECESSARILY LIMIT THE ITEMS OF WORK AND MATERIAL THAT MAY BE REQUIRED FOR A COMPLETE INSTALLATION. ALL SITE RELATED ITEMS ARE SUBJECT TO LOCAL JURISDICTION APPROVAL. CODE COMPLIANCE MUST BE DETERMINED AT THE LOCAL LEVEL.
1. THE COMPLETE FOUNDATION SUPPORT AND TIE DOWN SYSTEM.
2. RAMPS, STAIRS AND GENERAL ACCESS TO THE BUILDING.
3. PORTABLE FIRE EXTINGUISHER(S).
4. DRINKING FOUNTAIN OR BOTTLED WATER, BUILDING DRAINS, CLEANOUTS, SERVICE SINK AND HOOK-UP TO PLUMBING SYSTEM.
5. ELECTRICAL SERVICE HOOK-UP (INCLUDING FEEDERS) TO THE BUILDING.
6. THE MAIN ELECTRICAL PANEL AND SUB-FEEDERS
7. CONNECTION OF ELECTRICAL CIRCUITS CROSSING OVER MODULE MATELINE(S) - (MULTI-UNITS ONLY).
8. STRUCTURAL AND AESTHETIC INTERCONNECTIONS BETWEEN MODULES (MULTI-UNITS ONLY).
9. EXIT DISCHARGE LIGHTING (INCLUDING EMERGENCY)
10. WINDOW AND DOOR HIGH WIND STORM COVERINGS (PER CODE) REFER TO GENERAL NOTES 3, 6 & 10.

TABLE OF CONTENTS
PAGE . . . 1 OF 3
ELEVATIONS, GENERAL NOTES
PAGE . . . 2 OF 3
FLOOR PLAN, PLUMBING ELECTRICAL
PAGE . . . 3 OF 3
CROSS SECTION, FOUNDATION


 P.O. Box 1079 892 N. Broad St. Ellaville, GA 31806 (229) 937-2581 www.trcustominc.com
SUBMITTAL #TRC-1464 (2017) 13'-8"x64'-0" BUSINESS OCCUPANCY STOCK MODEL: TX/AL/LA DATE: NOVEMBER 2, 2017 DRAWN BY: DRS SCALE: N - T - S SHEET #: 1 of 3 DESTINATION: STOCK (UNKNOWN)

CLIMATE DESIGN CRITERIA:
CLIMATE ZONE: 2a

WINDOW & DOOR SPECIFICATIONS
1. DBL. PANE WINDOWS ARE REQUIRED FOR ALL CLIMATE ZONES. SEE THE COMCHECK ENERGY CALCULATIONS FOR THE MAXIMUM ALLOWED U-FACTOR AND SHGC.
2. THE MAXIMUM ALLOWABLE AIR LEAKAGE RATE FOR WINDOWS IS 0.3 CFM PER SQUARE FEET OF WINDOW AREA.
3. THE MAXIMUM ALLOWABLE AIR LEAKAGE RATE FOR EXTERIOR DOORS IS 0.3 CFM PER SQUARE FEET OF DOOR AREA.

EXT. DOOR SPECIFICATIONS:
1. H.D. ALUM W/ VIEW BLOCK 2. ALUMINUM WITH FOAM CORE 3. Uo = 0.32 4. ALLOWABLE AIR LEAKAGE RATES 0.3 CFM PER SQ. FT. OF DOOR AREA

WINDOW SPECIFICATIONS:
1. VINYL FRAME w/THERMAL BREAK 2. OPERABLE 3. DOUBLE PANE/LOW-E/CLEAR 4. Uo = 0.35 5. SHGC = 0.23 6. ALLOWABLE AIR LEAKAGE RATES 0.3 CFM PER SQ. FT. OF WIN. AREA


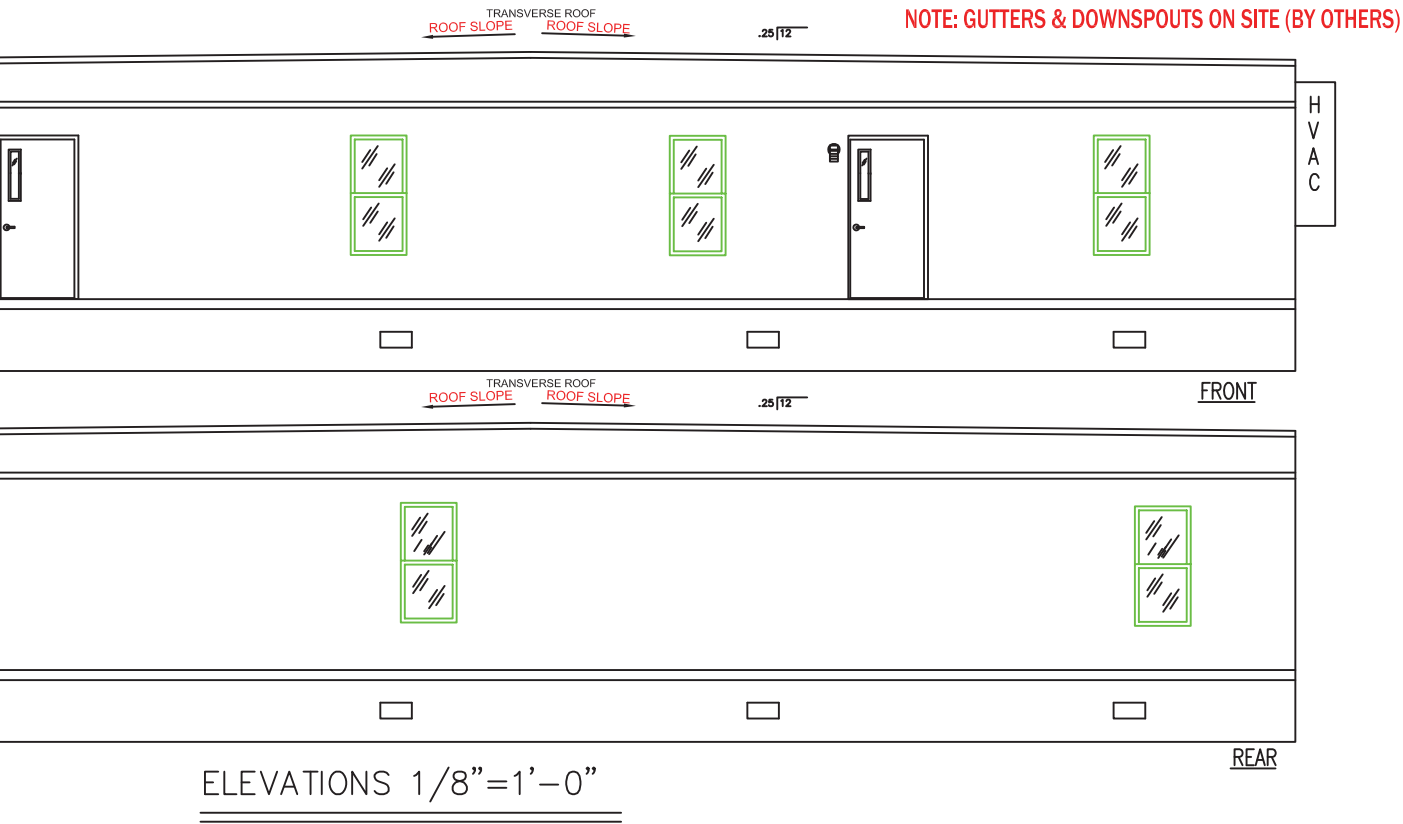


(1) SKIRT, SKIRT VENTILATION, & ACCESS TO BE PROVIDED & INSTALLED BY OWNER ON SITE.
(2) ALL GLASS IN DOORS & WITHIN 24" OF DOORS IS SAFETY GLAZED.
(3) HANDICAP ACCESS REQUIREMENTS TO BE PROVIDED & INSTALLED BY OWNER ON SITE.
(4) FOUNDATION ENCLOSURES(WHEN PROVIDED) MUST HAVE 1 SQUARE FOOT NET VENT AREA PER 150 SQ.FT. OF THE FLOOR AREA.
(5) AN 18"x24" MINIMUM CRAWL SPACE ACCESS TO BE SITE INSTALLED BY OTHERS.



TEXAS INDUSTRIALIZED BUILDING CODE COUNCIL
This document is approved pursuant to the Industrialized Housing and Buildings Act.
DRA No. 21 IBC ✓IRC
Date: 11 09 2017
DRA Signature: 

Reg. P.E. Firm Name: James E. Bradley Firm Reg. # F-1285
--

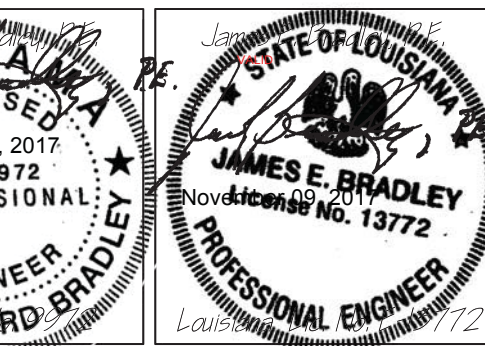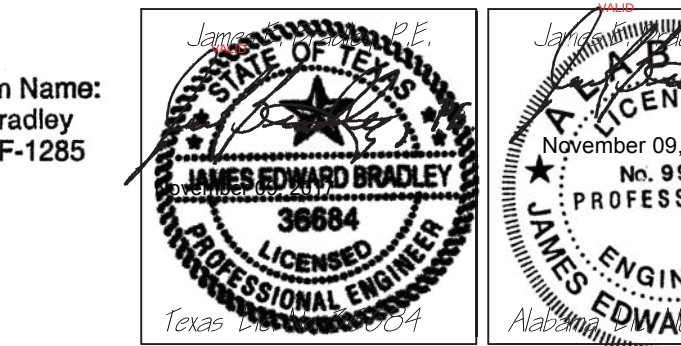

DESTINATION: STOCK (UNKNOWN)


FOUNDATION NOTES:

1. ALL FOUNDATION CONSTRUCTION, MATERIALS, AND INSTALLATION SHALL BE IN ACCORDANCE WITH ALL APPLICABLE STATE AND LOCAL CODES.
2. TIE-DOWN STRAPS TO BE 1-1/4"x .035" TYPE-1, FINISH B, GRADE 1 ZINC COATED STEEL STRAPPING CERTIFIED BY A REGISTERED ENGINEER OR ARCHITECT AS CONFORMING WITH ASTM D3953-91. TIE DOWN STRAPS AND CONNECTING HARDWARE SHALL HAVE 3150# MINIMUM WORKING CAPACITY.
3. EACH GROUND ANCHOR SHALL HAVE A WORKING CAPACITY NO LESS THAN THE SUM OF THE REQUIRED WORKING CAPACITIES OF ALL TIE DOWN STRAPS CONNECTED TO THE GROUND ANCHOR, AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. DESIGN OF GROUND ANCHOR, INCLUDING SHAFT LENGTH, NUMBER AND DIAMETER OF HELICES, ETC., TO BE AS SPECIFIED BY THE GROUND ANCHOR MANUFACTURER FOR THE ACTUAL SOIL TYPE ENCOUNTERED. IF THE HOLDING OR PULLOUT CAPACITIES OF GROUND ANCHORS ARE BELOW THE ASSUMED DESIGN VALUES, THE ARCHITECT/ENGINEER MUST BE CONSULTED FOR AN ALTERNATE ANCHORAGE DESIGN.
4. THE FIRST TIE-DOWN STRAP FROM ENDWALLS SHALL NOT EXCEED 1/2 THE MAXIMUM SPACING INDICATED.
5. ALL PIERS SHALL BE CONSTRUCTED OF CONCRETE MASONRY UNITS CONFORMING TO ASTM C90. MASONRY UNITS SHALL BE LAID IN TYPE M OR S MORTAR OR COVERED WITH SURFACE BONDING CEMENT INSTALLED IN ACCORDANCE WITH ITS LISTING. PIER FOOTINGS SHALL BE AS DESCRIBED ABOVE.
6. MINIMUM CONCRETE FOOTING COMPRESSIVE STRENGTH 2,500 PSI AT 28 DAYS.
7. ALL REINFORCEMENT BARS SHALL COMPLY WITH ASTM A615, GRADE 60. REINFORCEMENT BARS SHALL BE EQUALLY SPACED AND PLACED WITH 3" CLEARANCE FROM BOTTOM AND SIDES OF THE FOOTING.
8. SEE SHEET ONE FOR DESIGN LOADS.
9. I-BEAM SUPPORT PIERS MAY BE INSTALLED LATERALLY (90° FROM THE ORIENTATION SHOWN ON THE FOUNDATION PLAN). CENTERLINE OF EACH PIER MUST BE LOCATED DIRECTLY BELOW THE I-BEAM CENTERLINE.
10. SOIL BEARING CAPACITY SHOWN ON THIS PLAN IS ASSUMED. IF THE ACTUAL SOIL BEARING CAPACITY IS LESS THAN 2,000 PSF, THE ARCHITECT/ENGINEER MUST BE CONSULTED FOR REQUIRED ALTERNATE FOUNDATION DESIGN. FOOTINGS SHALL BE PLACED ON NON-EXPANSIVE SOILS ONLY.
11. INSTALL BLOCK PIER ON EACH SIDE OF ALL EXTERIOR DOOR OPENINGS. (MANUFACTURER'S RECOMMENDATION ONLY - OPTIONAL WHEN NOT SHOWN) SLIGHT ADJUSTMENT MAY BE REQUIRED TO INSURE OPENABILITY AFTER INSTALLATION OF BUILDING IS COMPLETE.
12. THE AREA UNDER FOOTINGS AND FOUNDATIONS SHALL HAVE ALL VEGETATION, STUMPS, ROOTS, AND FOREIGN MATERIALS REMOVED PRIOR TO THEIR CONSTRUCTION.
13. THE FOUNDATION DIMENSIONS SHOWN ARE NOMINAL. AN INCREASE IN MODULE WIDTH SHOULD BE EXPECTED DUE TO MODULE EXPANSION, SETTING TOLERANCES, ETC. THE FOUNDATION CONTRACTOR SHOULD CONSULT WITH THE MANUFACTURER OF THE MODULES PRIOR TO CONSTRUCTION OF THE FOUNDATION TO DETERMINE THE AMOUNT OF INCREASED WIDTH TO BE ADDED TO THE NOMINAL DIMENSIONS SHOWN ABOVE.

FOUNDATION, PIER BLOCKING, FOOTING, AND ANCHORING DETAILS SHOWN ON THESE PAGES ARE TO BE USED AS A REFERENCE SOURCE ONLY. IT WILL BE THE OWNERS RESPONSIBILITY TO CHECK WITH THE LOCAL CODE AUTHORITY TO VERIFY SPECIFIC REQUIREMENTS AFFECTING THE INSTALLATION, SETUP, AND UTILITY CONNECTION TO THIS BUILDING. T&R CUSTOM ASSUMES NO RESPONSIBILITY FOR LOCAL, COUNTY, AND MUNICIPAL CODE REQUIREMENTS FOR THIS STRUCTURE. ALTERNATE FOUNDATION PLANS MAY BE DESIGNED BY OTHERS AND SUBJECT TO APPROVAL

ALTERNATE FOUNDATION PLAN MAY BE DESIGNED BY OTHERS

ADD A PIER DIRECTLY UNDER EACH SIDE OF EXTERIOR DOORS TO PREVENT MISALIGNMENT AND DRAGGING. MAY REST ON 'ABS' PADS SUBJECT TO APPROVAL

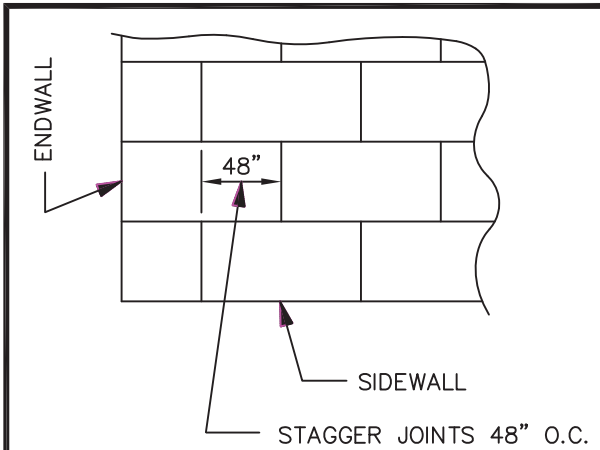


MULEHIDE:
FR DECK PANEL 'C' TO BE FASTENED TO TRUSSES W/8D SINKER NAILS @ 6" O.C. ON EDGES AND 12" O.C. FIELD IN ZONE 1 (ROOF INTERNAL FIELD)
@ 6" O.C. ON EDGES & 9" O.C. FIELD IN ZONE 2 (3' WIDE ROOF EDGES @ PERIMETER)
@ 6" O.C. ON EDGES & 6" O.C. FIELD IN ZONE 3 (3'x3' AREA @ ROOF CORNERS)


ROOF SHEATHING DETAIL

WALL LOAD	7.34'x7.34'x11psf	= 593#
FLOOR LOAD	6.83'x8'x(50+10psf)	= 3,278#
ROOF LOAD	6.83'x8'x(20+14psf)	= 1,858#
	TOTAL LOAD	= 5,729#
AREA FTG. REQUIRES	5,729 / 2,000psf	= 2.86 sq.ft.
AREA	24x24 / 144	= 4.00 sq.ft.


NOTE:
THE SPACING FOR PIERS ON THIS FOUNDATION ASSUMING THE SOIL IS 1500 PSF CAPACITY IS 3'-7".

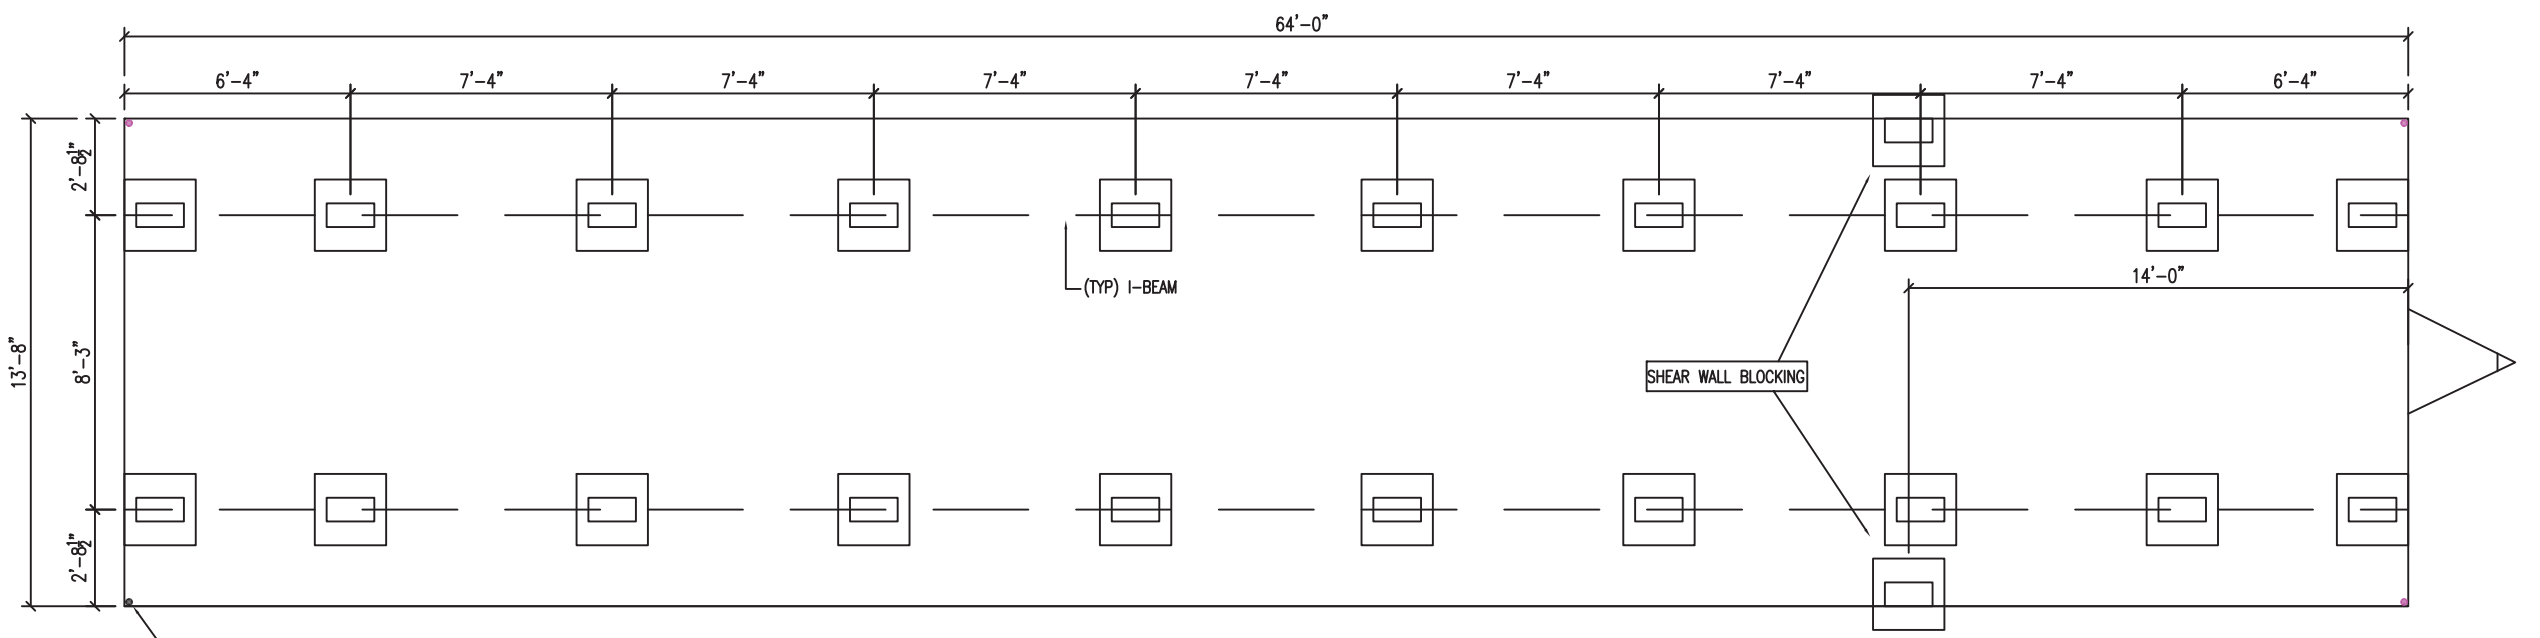


- (1) MIN. SOIL BEARING CAPACITY 2,000 P.S.F. REQUIRED.
- (2) FOOTING DETAILS TO BE VERIFIED WITH LOCAL CODE AUTHORITY FOR ADDITIONAL SPECIFIC REQUIREMENTS. DETAILS PROVIDED ARE SUGGESTED ONLY & LOCAL CONDITIONS MAY REQUIRE VARIANCES AND ADDITIONS.

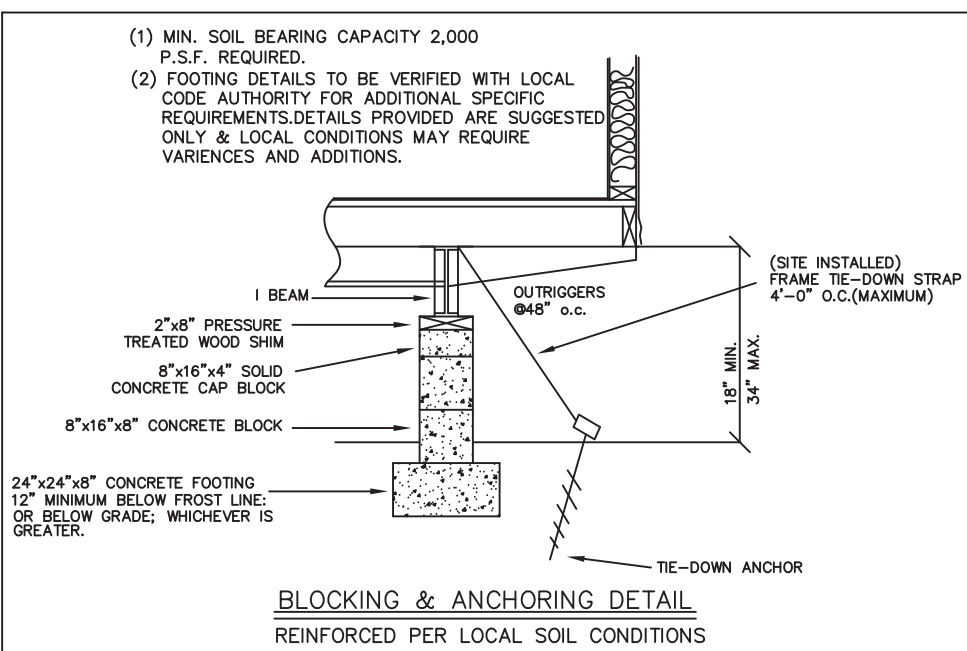

FOUNDATION PLAN 3/16"=1'-0"

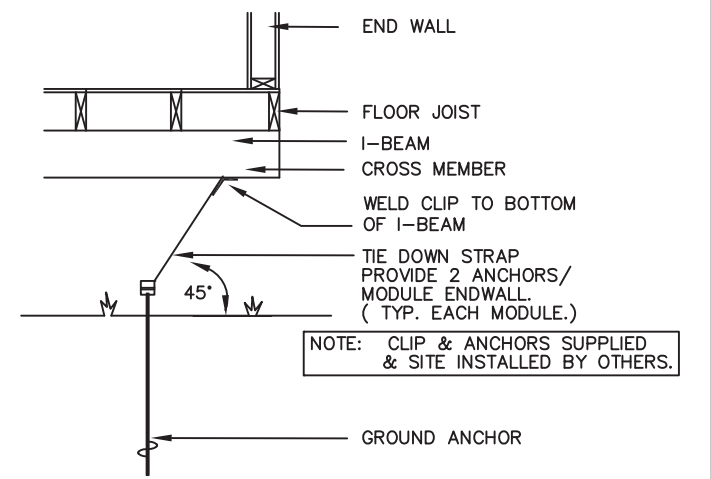

ENDWALL TIE DOWN DETAIL

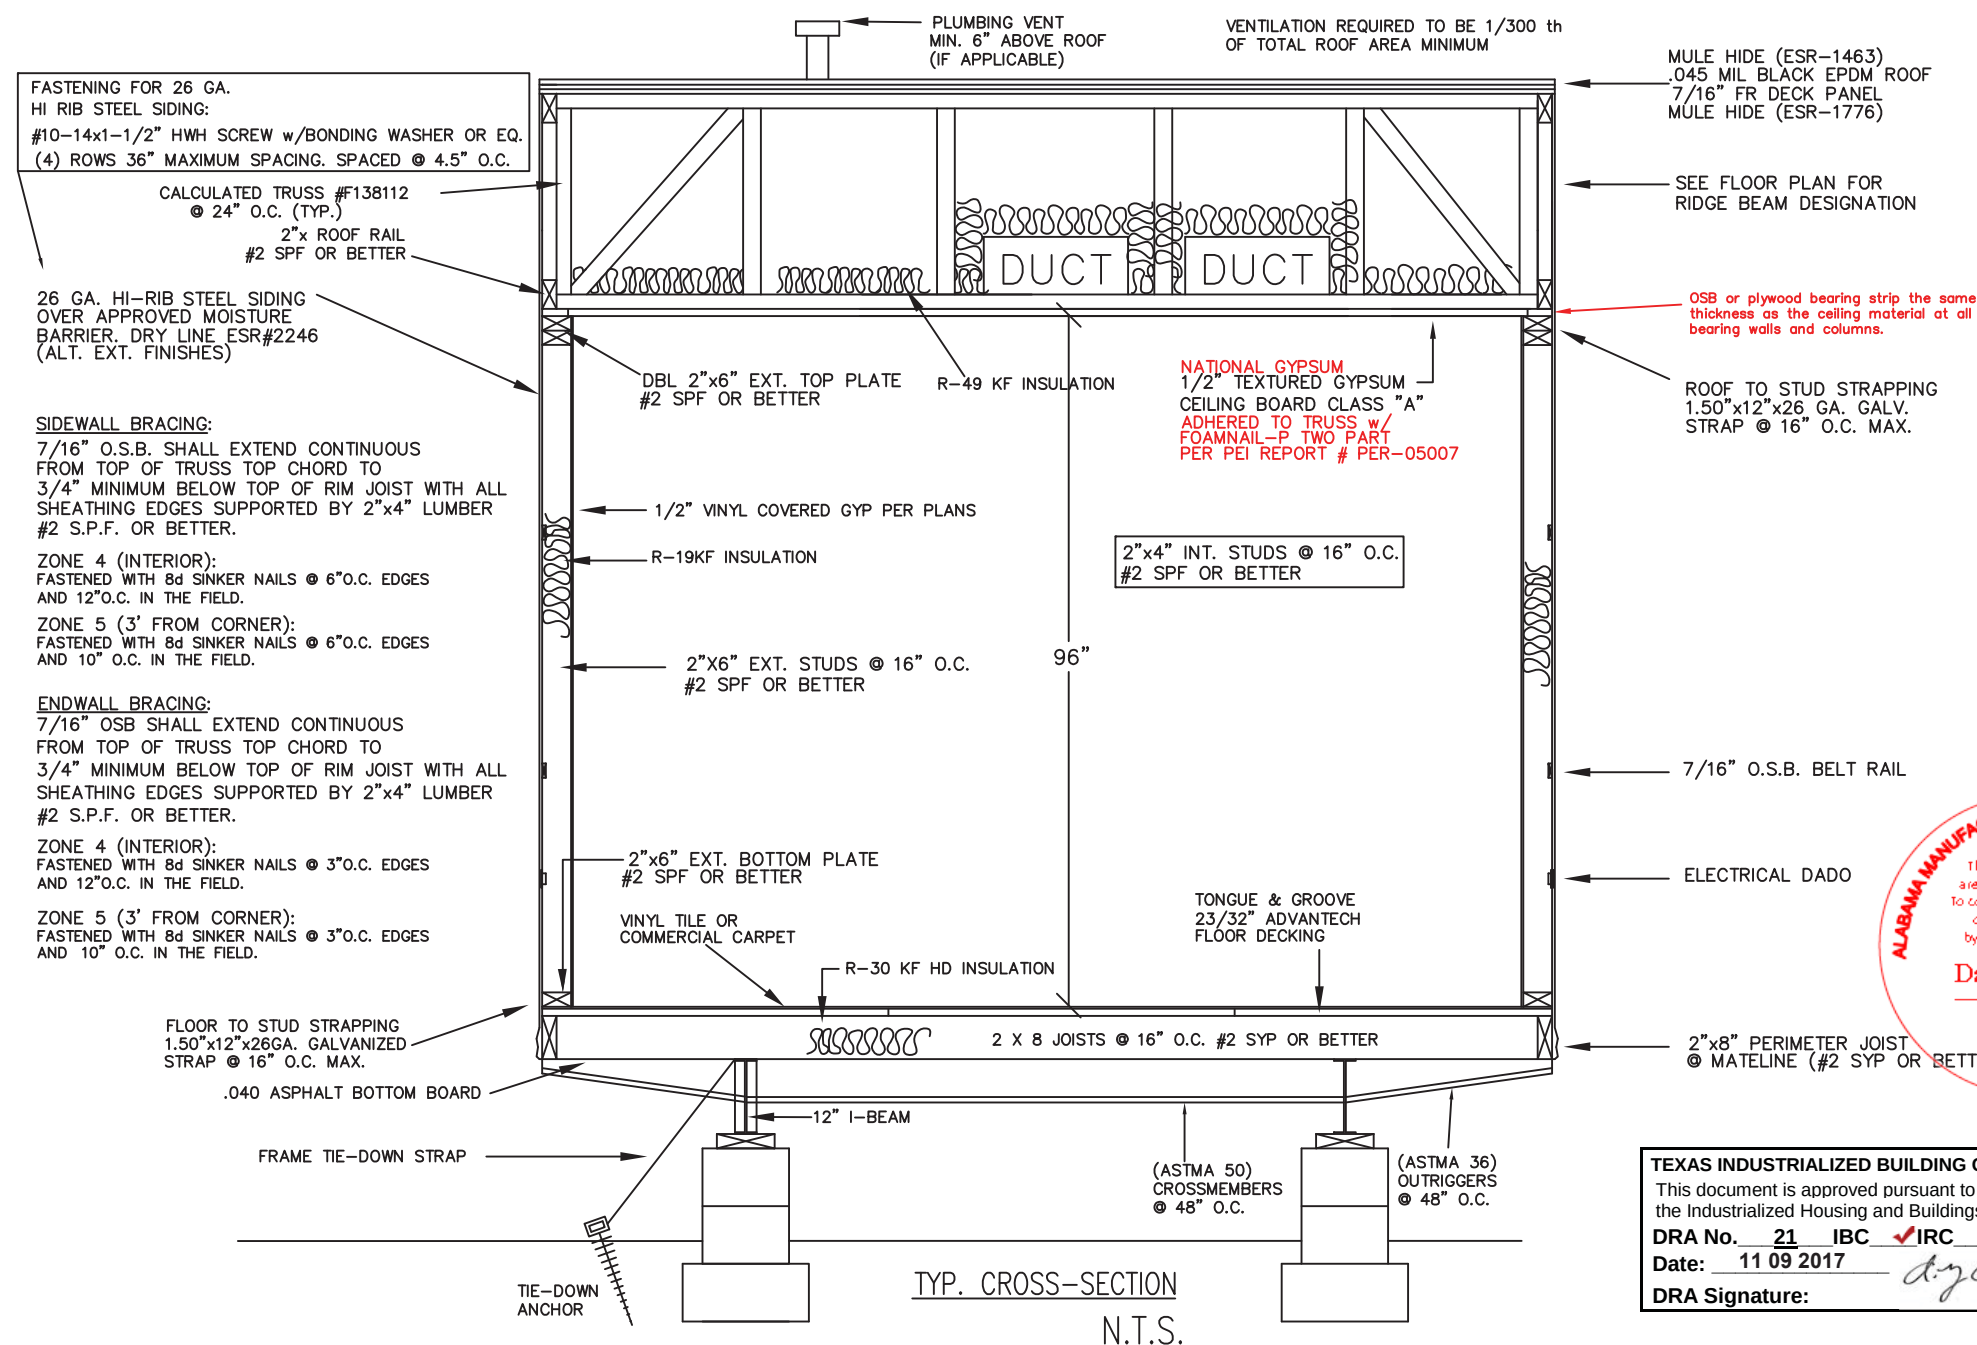

SUPPLY RISERS - N.T.S.




SUPPLY LINE NOTES

- 1) ALL SUPPLY LINES TO BE CPVC EXCEPT WHERE NOTED OTHERWISE.
- 2) ALL JOINTS TO BE BY MANUFACTURER APPROVED METHODS.
- 3) ALL FITTINGS TO BE PLASTIC, CHROME, BRASS, OR OTHER APPROVED MATERIAL.
- 4) ALL SUPPLY LINES TO HAVE APPROVED SHUTOFF VALVES.
- 5) LINES TO BE SUPPORTED VERTICALLY MAXIMUM 48" O.C.
- 6) LINES TO BE SUPPORTED HORIZONTALLY MAXIMUM 32" O.C.
- 7) ALL PIPING BELOW FLOOR NOT CONCEALED IN FLOOR CAVITY TO BE INSULATED WITH MIN. R-4.
- 8) INTERCONNECTION OF SEPARATE WATER HEATERS TO BE DONE ON SITE BY LICENSED PLUMBER AND SUBJECT TO LOCAL CODE JURISDICTION.




APPROVED
11 09 2017

* NOTE: THERMAL EXPANSION TANK, BACKFLOW PREVENTER, AND CUT-OFF VALVE IF REQUIRED TO BE SUPPLIED AND INSTALLED ON SITE BY OTHERS.

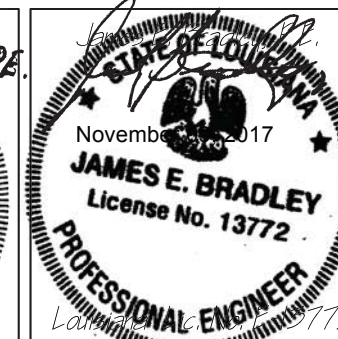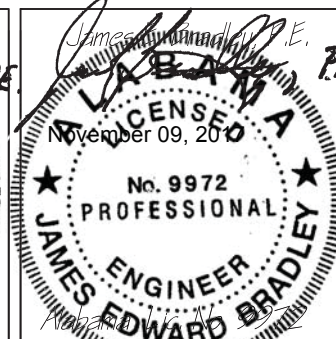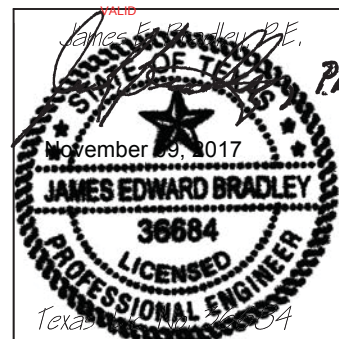

DWV NOTES

- 1) PIPING SHALL BE PVC SCHEDULE 40
- 2) ALL JOINTS SHALL BE MADE WITH FITTING EITHER SOLVENT WELDED OR THREADED ACCORDING TO APPROVED METHODS.
- 3) VERTICAL PIPING SHALL BE SUPPORTED AT BASE, MIDDLE, AND TOP.
- 4) HORIZONTAL PIPING SHALL BE SUPPORTED MINIMUM 48" O.C. AND AT EACH CHANGE OF DIRECTION.
- 5) ALL P-TRAP EXTENSION ARMS OVER 36" MIN. MUST BE SUPPORTED AT BASE AND AS CLOSE TO P-TRAP AS POSSIBLE.
- 6) PIPING 2.50" AND BELOW TO HAVE .25" FALL IN DIRECTION OF FLOW.
- 7) PIPING 3.00" AND ABOVE TO HAVE .125" FALL IN DIRECTION OF FLOW.
- 8) ALL VENTS THRU ROOF MUST PENETRATE ROOF COVERING A MIN. OF 6" AND MUST BE PROPERLY FLASHED.
- 9) FLASHING TO BE LEAD, COPPER, ALUMINUM, PLASTIC, OR NEOPRENE OF AN APPROVED TYPE.
- 10) ALL PIPING BELOW FLOOR NOT CONCEALED IN FLOOR CAVITY TO BE INSULATED WITH R-4 OR BETTER.

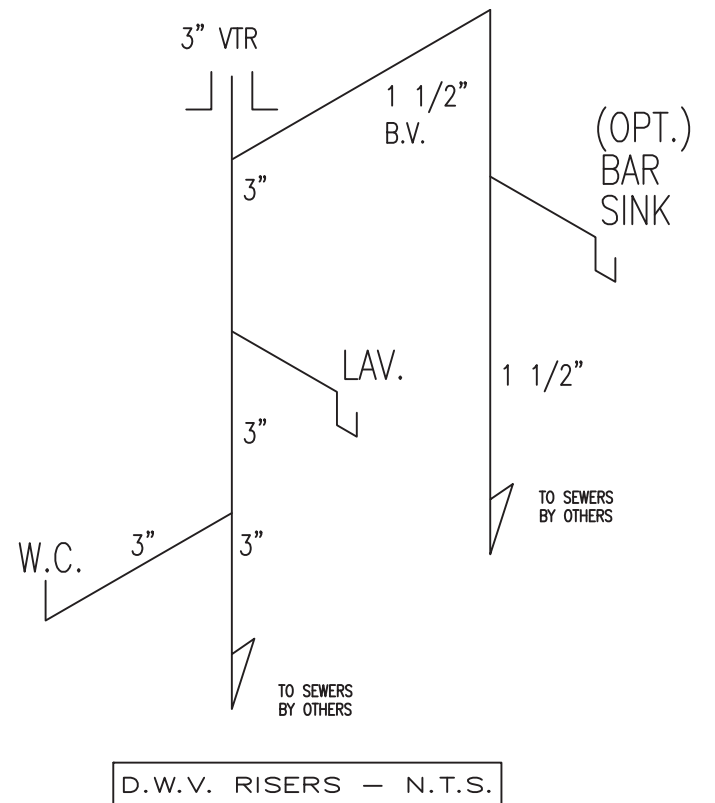

T&R Custom INCORPORATED	
P.O. Box 1079 892 N. Broad St. Ellaville, GA 31806 (229) 937-2581 www.trcustominc.com	
SUBMITTAL #: TRC-1464 (2017)	
13'-8"x64'-0" BUSINESS OCCUPANCY	
STOCK MODEL: TX/AL/LA	
DATE: NOVEMBER 2, 2017	
DRAWN BY: DRS	
SCALE: N - T - S	SHEET #: 1 of 3
DESTINATION: STOCK (UNKNOWN)	